



A-101 Central
M-2

DRAWING NUMBER


DATE: 3-13-92

DRAWING NUMBER

WEST STREET

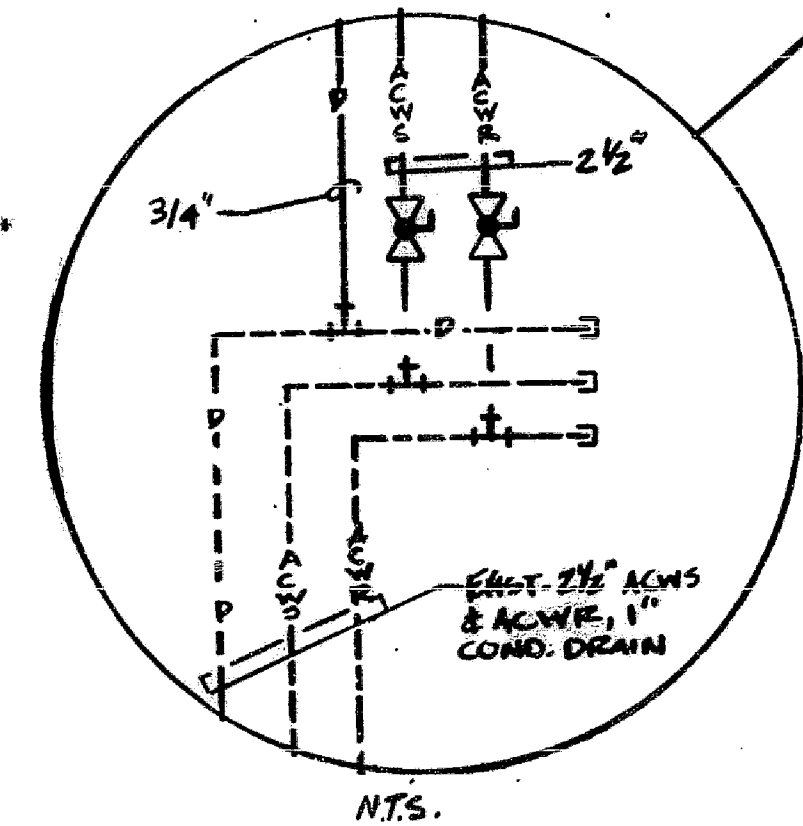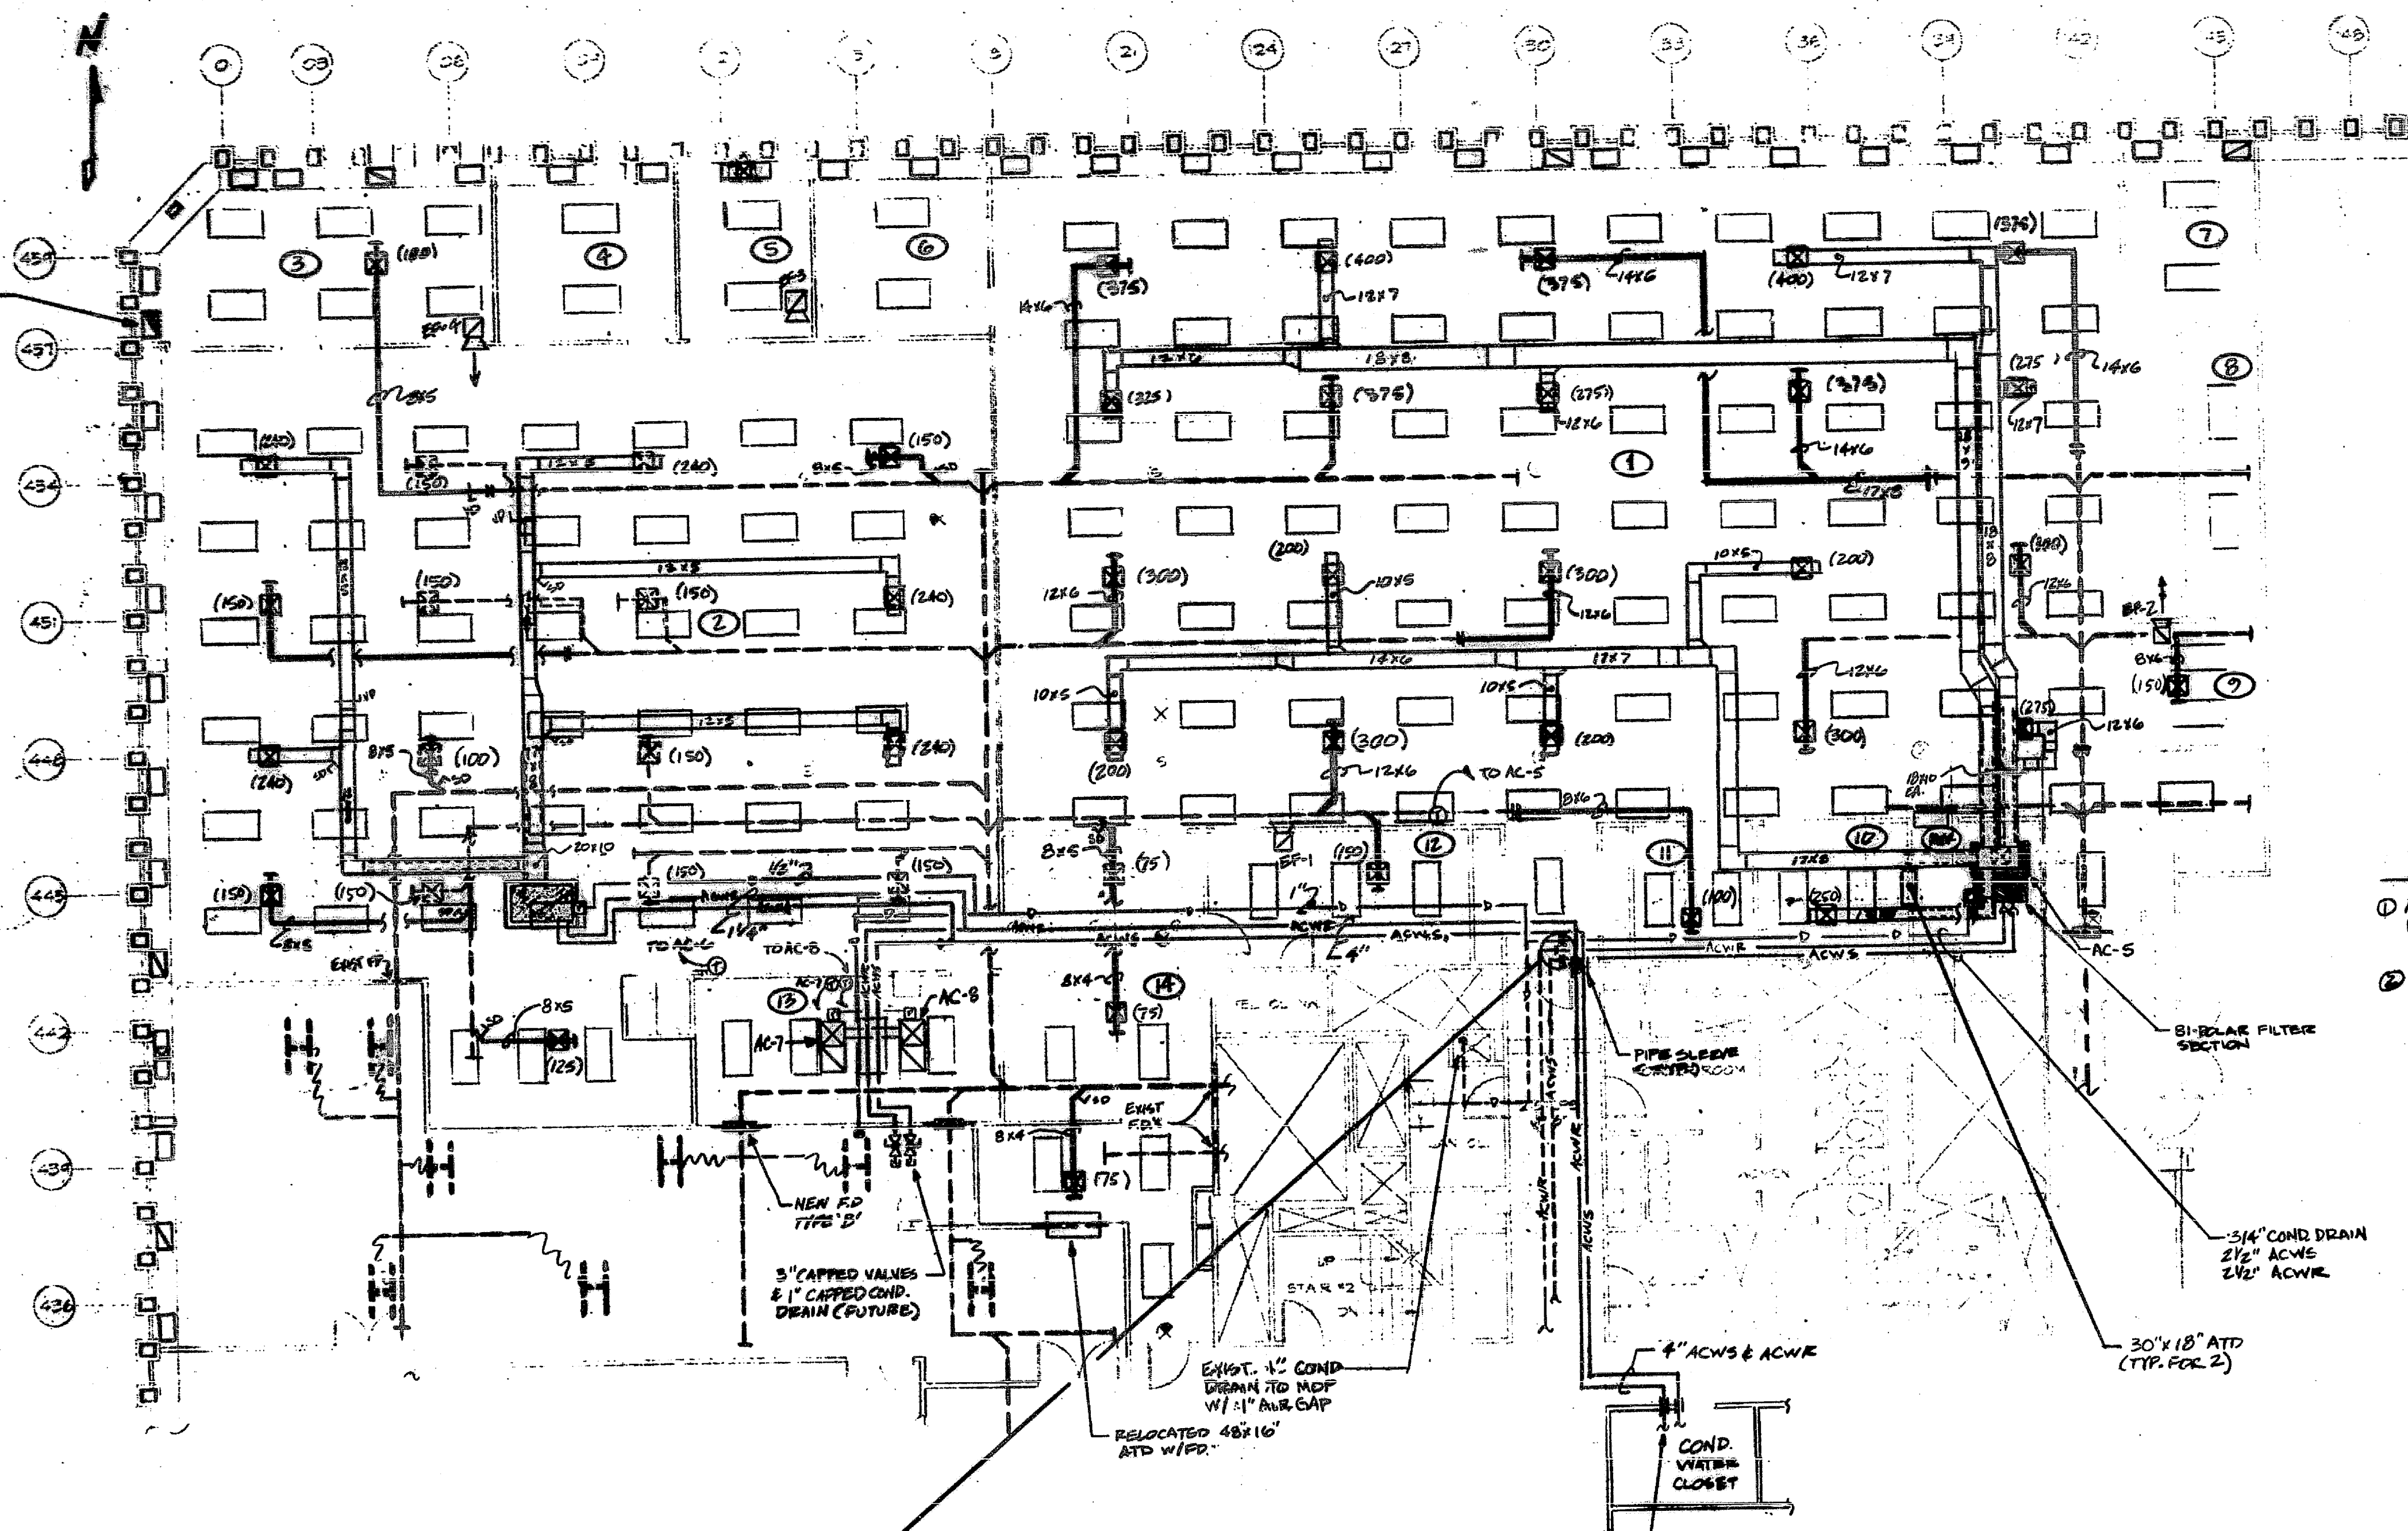

PLAN VIEW
1/8" = 1'-0"

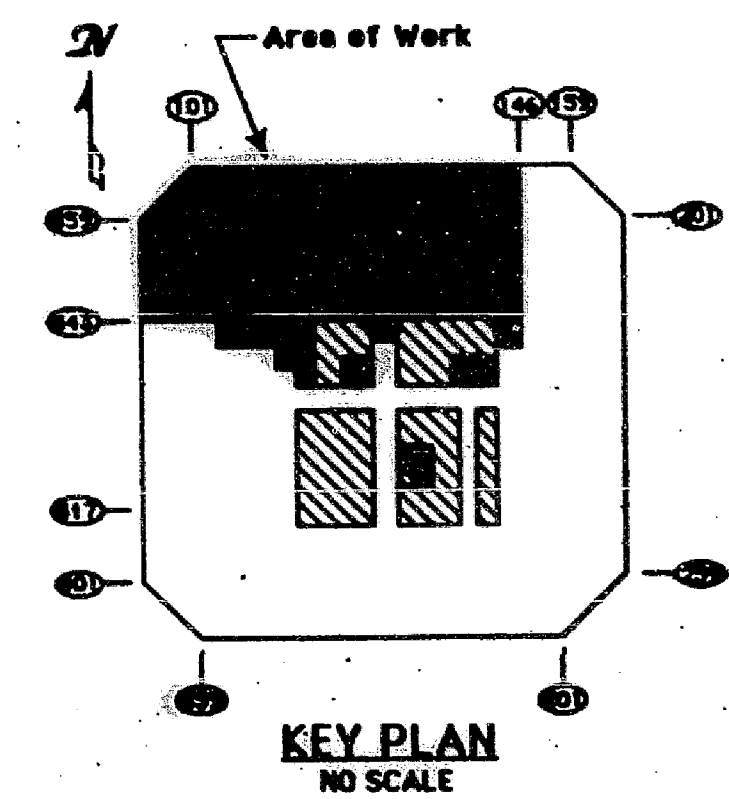

LEGEND

- NEW DUCTWORK SUPPLEMENTAL COOLING
- NEW BASE BUILDING DUCTWORK
- EXISTING BASE BUILDING DUCTWORK
- NEW SUPPLY AIR DIFFUSER
- EXISTING SUPPLY AIR DIFFUSER TO REMAIN
- EXISTING DOUBLE POUCH TO REMAIN
- FULL CAPACITY INDUCTION UNIT
- 1/2 CAPACITY INDUCTION UNIT TO REMAIN
- EXISTING FULL CAPACITY INDUCTION UNIT TO BE DECREASED TO 1/2 CAPACITY
- 1 1/2 CAPACITY INDUCTION UNIT
- CEILING MOUNTED EXHAUST FAN
- AIR TRANSFER DUCT
- NEW FIRE DAMPER
- SPLITTER DAMPER
- VOLUME DAMPER
- CFM
- THERMOSTAT
- NEW CONDENSER WATER SUPPLY
- NEW CONDENSER WATER RETURN
- NEW CONDENSATE DRAIN PIPING
- EXISTING CONDENSER WATER SUPPLY
- EXISTING CONDENSER WATER RETURN
- EXISTING CONDENSATE DRAIN PIPING
- CONDENSATE PUMP
- GATE VALVE
- REDUCER
- BALL VALVE
- PLUG VALVE

GENERAL NOTES

1. ALL LIGHTING FIXTURES ARE AIR HANDLING TYPE AND WILL BE USED FOR RETURN AIR PURPOSES
2. SEE DWG. M-4 FOR MECHANICAL DETAILS, AC UNIT HANGING AND PIPING DIAGRAMS, DUCT HANGING DETAIL, VENTILATION INDEX, ETC.

2	REVISED AS PER P.A. COMMENTS	7-3-92
1	REVISED AS PER P.A. COMMENT	5-1-92
REV. NO.	DESCRIPTION	DATE
Canfor Fitzgerald Securities One World Trade Center Floor 104 New York, NY 10048		
MECHANICAL PLAN John C. Westrick & Associates CONSULTING ENGINEERS 2110 Maple Avenue South Placerville, CA 95662 (909) 861-4170 FAX (909) 763-8884		
SCALE: AS NOTED	DRAWN BY: J.C.W.	CHECKED BY: J.C.W.
DATE: 3-13-92	JOB NO.: 92111-1	10-2